



ARISTOTLE UNIVERSITY OF THESSALONIKI

TEST REPORT

Measurement of Sound Absorption Coefficient measured according
with EN ISO 354:1993 in a Reverberation room.

TEST REPORT NUMBER

ABS.01.2023

DATE

29.12.2023

LABORATORY OF ARCHITECTURAL TECHNOLOGY

54124 Thessaloniki, University Campus, Tel: +30 2310 995501, Fax: +30 2310 995504, technology@arch.auth.gr, www.window.gr

DEPARTMENT OF ARCHITECTURAL DESIGN & ARCHITECTURAL TECHNOLOGY - / SCHOOL OF ARCHITECTURE / FACULTY OF TECHNOLOGY

Digital Document Certification

You may validate this document by scanning
the QR code or entering the Document ID
at docs.gov.gr/validate



Document code: f j g V 6 T z m D 8 I Y 1 G q v L R I A T Q

Page: 1/6

1. GENERAL CONDITIONS

The test result reflects exclusively on the properties of the specific test specimen which was provided by the Client to the Laboratory facility on his own responsibility. The tests have taken place under laboratory conditions,

The Laboratory maintains the right to use the test results in scientific publications, scientific papers, research reports, and any other kind of studies of purely research or scientific nature, without revealing the name of the Client or the type of the product.

The Laboratory does not have Accreditation for the Measurement of the Sound Absorption Coefficient.

2. PROCEDURES

2.1 Applied Standards

EN ISO 354 1993, Acoustics – Measurement of sound absorption in a reverberation room

EN ISO 11654:1997, Acoustics — Sound absorbers for use in buildings — Rating of sound absorption

2.2 Test Procedure

The test environment consists of a parallelepiped shaped reverberation room with a rectangular base and the following size specifications.

- Plan dimensions 7,76 x 6,91 m
- Height 4,01 m
- Volume 215 m3

The test involves measuring reverberation times of the empty room T1 and reverberation room containing the test specimen T2 in order to determine said specimen's sound absorption coefficient α_s . The reverberation time T corresponds to the time taken in seconds for the sound pressure level to decay 60dB after the noise source has stopped.

Throughout the test, the specimen was laid on the floor of the reverberation room. It was also ensured that the sides of the specimen were not parallel to the walls of the reverberation room and were situated at a distance of not less than 1m from said walls and every microphone position.

Measurements were taken in 1/3 octave bands within the range 100Hz to 5000Hz, as requested by the EN ISO 354 : 1993 standard.

The sound absorption coefficient α_s was calculated using the following formulas

$$\alpha_s = \frac{A}{S}$$

$$A = A_2 - A_1 = 55,3 \cdot \frac{V}{c} \cdot \left(\frac{1}{T_2} - \frac{1}{T_1} \right)$$

$$c = 331 + 0,6 \cdot t$$

Laboratory of Architectural Technology - School of Architecture - Faculty of Technology A.U.T

Digital Document Certification

You may validate this document by scanning the QR code or entering the Document ID at docs.gov.gr/validate



Document code: f j g V 6 T z m D 8 I Y 1 G q v L R I A T Q

Page: 2/6

Fq (Hz)	T1	T2	Room V in m ³	test specimen S in m ²	Room Temprature in °C	Speed of Sound in m/sec	A1	A2	A	as 1/3 Octave	a% 1/3 Octave
100	1.78	1.39	215	12	20	343	19.47	24.94	5.46	0.46	45.53
125	1.74	1.23	215	12	20	343	19.92	28.18	8.26	0.69	68.83
160	1.58	1.01	215	12	20	343	21.94	34.32	12.38	1.03	103.18
200	1.71	1.1	215	12	20	343	20.27	31.51	11.24	0.94	93.68
250	1.48	0.98	215	12	20	343	23.42	35.37	11.95	1.00	99.58
315	1.34	0.85	215	12	20	343	25.87	40.78	14.91	1.24	124.27
400	1.25	0.81	215	12	20	343	27.73	42.79	15.06	1.26	125.53
500	1.22	0.77	215	12	20	343	28.41	45.02	16.60	1.38	138.37
630	1.21	0.78	215	12	20	343	28.65	44.44	15.79	1.32	131.61
800	1.4	0.86	215	12	20	343	24.76	40.31	15.55	1.30	129.56
1000	1.49	0.88	215	12	20	343	23.26	39.39	16.13	1.34	134.38
1250	1.76	0.97	215	12	20	343	19.70	35.74	16.04	1.34	133.67
1600	1.92	1.04	215	12	20	343	18.05	33.33	15.28	1.27	127.30
2000	1.84	1.04	215	12	20	343	18.84	33.33	14.49	1.21	120.76
2500	1.8	1.04	215	12	20	343	19.26	33.33	14.07	1.17	117.27
3150	1.69	1.01	215	12	20	343	20.51	34.32	13.81	1.15	115.08
4000	1.49	0.96	215	12	20	343	23.26	36.11	12.84	1.07	107.03
5000	1.34	0.9	215	12	20	343	25.87	38.51	12.65	1.05	105.39

where as = sound absorption coefficient

A = equivalent acoustic absorption area of test specimen

S = surface area of test specimen

A2 = equivalent sound absorption area of reverberation room containing test specimen

A1 = equivalent sound absorption area of empty reverberation room

V = effective volume of empty reverberation room

c = propagation speed of airborne sound

T2 = reverberation time of reverberation room containing test specimen

T1 = reverberation time of empty reverberation room

t = temperature of air in reverberation room

2.3 Equipment used

Apparatus	Type	Manufacturer	Serial Number
Handheld Real time sound analyzer	XL2 Type Approval Class1 (with room acoustics and sound insulation extensions)	NTI Acoustics	A2A-11069-E0
Microphone Pre-Amp	MA 220	NTI Acoustics	005933
Microphone	MC230a	NTI Acoustics	A18779
Sound Calibrator	Type 105	Pulsar Instruments	98287
Sound Calibrator pinstiphone	Type 4220	Brüel & Kjær	894012
Sound Source	Type 4224	Brüel & Kjær	

All the Equipment used, during measurements, have, valid certifications

Laboratory of Architectural Technology - School of Architecture - Faculty of Technology A.U.T

Digital Document Certification



You may validate this document by scanning the QR code or entering the Document ID at docs.gov.gr/validate

Document code: fjgV6TzmD8IY1GqvLR1ATQ

Page: 3/6

3. TEST SPECIMEN

3.1 Description


Product:	Mineral wool roof covering panel
Manufacturer:	Metallemporiki Th. Makris S.A.
Client:	Metallemporiki Th. Makris S.A.
Address:	6th km Larissa-Sikurio, 41500, Larissa, tel 2410 575207, e-mail: makris@metallemporiki.gr
Installation:	Metallemporiki Th. Makris S.A.
Product name:	Mineral wool Perforated roof covering panel 120mm
Production date:	09/12/2023
Sample dimensions:	6 panels of 1000x2000 mm

3.2 Construction

The test specimen comprises an assembly of 6 Mineral wool roof covering panels fitted to the floor of the reverberation room. The size specifications of the specimen are as follows.

- Length of modular panel = 2000mm
- Width of modular panel = 1000mm
- Thickness of modular panel = 120mm
- Overall length of specimen = 4000mm
- Overall width of specimen = 3000mm
- Thickness of specimen = 120mm

3.3 Drawing

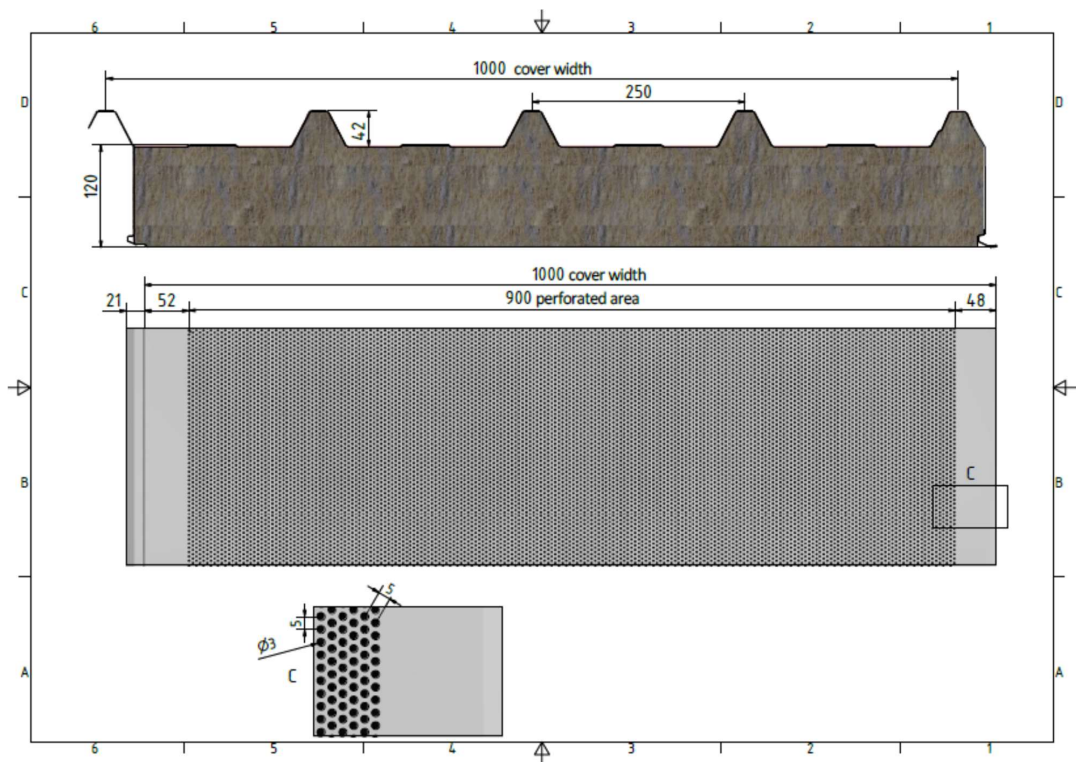

* The drawings have been prepared by the Client.

Laboratory of Architectural Technology - School of Architecture - Faculty of Technology A.U.T

Digital Document Certification


You may validate this document by scanning the QR code or entering the Document ID at docs.gov.gr/validate



Document code: fjgV6TzmD8IY1GqvLR1ATQ

Page: 4/6

4. TEST RESULTS

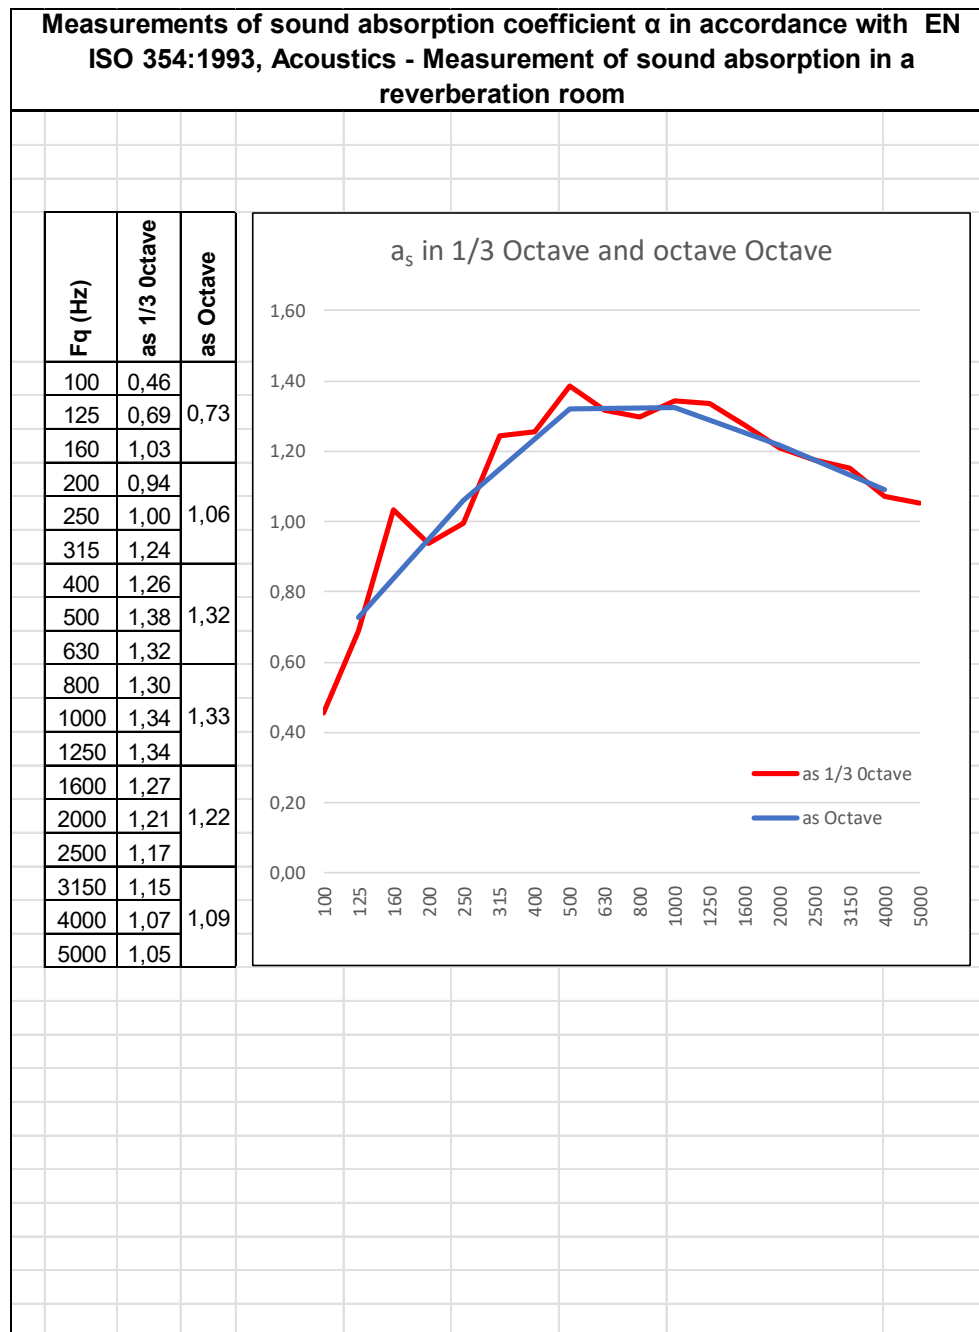

Laboratory of Architectural Technology - School of Architecture - Faculty of Technology A.U.T


Digital Document Certification

You may validate this document by scanning the QR code or entering the Document ID at docs.gov.gr/validate



Document code: fjgV6TzmD8IY1GqvLR1ATQ

Page: 5/6

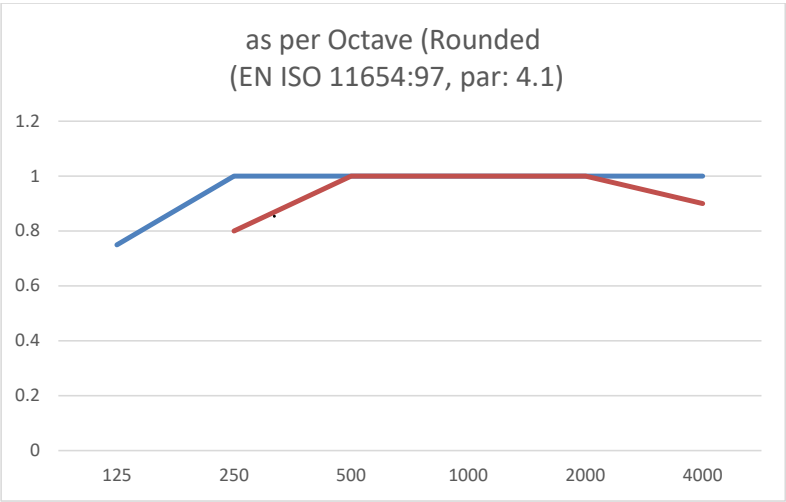

a _s Octave	a _p per Octave (Rounded (EN ISO 11654:97, par: 4.1	Final mean value
0,73	0,75	0,75
1,06	1,05	1,00
1,32	1,30	1,00
1,33	1,35	1,00
1,22	1,20	1,00
1,09	1,10	1,00

Weighted sound absorption coefficient a _w	1,00
Sound absorption class	A

Θεσσαλονίκη/Thessaloniki, 29.12.2023

Vasileios Vasileiadis Vasileios Vasileiadis
02.01.2024 12:44

Panagiotis Karampatzakis
MSc Architect, Acoustic Consultant

Vasilios Vasiliadis
Mechanical, PhD Engineer
Measurement Engineer

Laboratory of Architectural Technology - School of Architecture - Faculty of Technology A.U.T

Digital Document Certification

You may validate this document by scanning
the QR code or entering the Document ID
at docs.gov.gr/validate



Επιβεβαιώνεται το γνήσιο. Υπουργείο
Ψηφιακής Διακυβέρνησης / Verified by the Ministry
of Digital Governance, Hellenic Republic
20231231202210+02'00'

Signature:
ΠΑΝΑΓΙΩΤΗΣ ΚΑΡΑΜΠΑΤΖΑΚΗΣ /
PANAGIOTIS KARAMPATZAKIS
Father's name: ΣΤΑΥΡΟΣ / STAVROS
TIN: 073567906
Date of signature: 31/12/2023 20:20:48